

Master Flow® Roof Mount Power Ventilators Installation Instructions

Information Sheet

Updated: 2003



*Quality You Can Trust Since 1886...
From North America's Largest Roofing Manufacturer™*



Roof Mounted Power Vent Installation Instructions



visit us at www.gaf.com

Quality You Can Trust Since 1886...from
North America's Largest Roofing And Ventilation Manufacturer

Master Flow Hdqts.: 877.GAF.COOL
(877.423.2665)

Eastern Sales Office: 732.297.0091
Central Sales Office: 815.372.9701
Southeast Sales Office: 813.248.6202

Southwest Sales Office: 214.637.1060
Western Sales Office: 909.360.4200
Canadian Sales Office: 800.555.1852

©2003 GAF Materials Corporation 1361 Alps Road • Wayne, NJ 07470



WARNING

COMPLETE AND RETURN WARRANTY REGISTRATION FORM ON BACK COVER.

(Warranty registration not required for coverage)

SAVE these instructions. READ all instructions before starting the installation.

To reduce the risk of fire, electric shock or injury to persons, observe the following precautions:

- ① Use appropriate safety glasses, gloves, hard hats, restraints and other equipment to avoid accidents.
- ② Observe all applicable building codes.
- ③ Use this unit only in the manner intended by the manufacturer. If you have questions, contact the manufacturer.
- ④ Before servicing or cleaning unit, switch power off at service panel and lock service disconnecting means (power supply) to prevent power from being switched on accidentally. When the service disconnecting means (power supply) cannot be locked, securely fasten a prominent warning device, such as a tag, to the service panel.
- ⑤ Installation work and electrical wiring must be done by qualified person(s), in accordance with all applicable codes and standards, including fire rated construction.
- ⑥ Sufficient air is needed for proper combustion and exhausting of gases through the flue (chimney) of fuel burning equipment to prevent back drafting. Follow the heating equipment manufacturer's guideline and safety standards such as those published by the National Fire Protection Association (NFPA), and the American Society for Heating, Refrigeration and Air Conditioning Engineers (ASHRAE), and the local code authorities.
- ⑦ When cutting or drilling into walls or ceiling, do not damage electrical wiring or other hidden utilities.
- ⑧ Ducted fans must always be vented to the outdoors.
- ⑨ Make sure blade is on tight. Ensure the set screw is securely tightened.

CAUTION:

For general ventilating use only. Do not use to exhaust hazardous or explosive materials and/or vapors. This fan has an unguarded impeller. Do not use in locations readily accessible to people or animals.

WARNING:

Do not use an extension cord. This fan must be connected to a 120 volt, 60 Hz, grounded circuit only. Do not use this fan with any solid state speed control. To reduce the risk of fire or electrical shock, use only with manufacturer approved controls. Do not use on a roof pitch below 2/12.



TOOLS REQUIRED:

- Drill
- Caulking Gun
- Utility Knife
- Claw Hammer
- Power Saber or Jig Saw and/or Handsaw
- Extension Cord
- Galvanized Roofing Nails
- Screw Driver
- Safety Eyewear
- Ladder
- Pencil or Marker

NUMBER OF ROOF MOUNT POWER VENTS REQUIRED

Attic Square Foot	Model #	Roof pitch 3/12	Roof pitch 6/12	Roof pitch 9/12	Roof pitch 12/12
800	PR1D	1	1	1	1
	PR2D	1	1	1	1
	PR3D	1	1	1	1
1200	PR1D	1	1	2	2
	PR2D	1	1	1	2
	PR3D	1	1	1	1
1600	PR1D	1	2	2	4
	PR2D	1	2	2	3
	PR3D	1	1	2	2
2000	PR1D	2	2	3	4
	PR2D	1	2	2	4
	PR3D	1	2	2	3
2400	PR1D	2	2	4	4
	PR2D	1	2	3	4
	PR3D	1	2	2	3
2800	PR1D	2	3	4	NR
	PR2D	2	2	4	4
	PR3D	1	2	3	4
3200	PR1D	2	4	4	NR
	PR2D	2	3	4	NR
	PR3D	1	2	3	4


1

FOR PROPER ATTIC VENTILATION---INTAKE *

ATTIC SIZE (SQ. FT.)	MODEL#	SQ. IN. REQUIRED	# OF UNDEREAVE VENTS				# OF 8 ft. LSV8 SOFFIT VENTS	FASCIA VENTS	
			EAC	EAC	EAC	EAP		2080 COBRA®	2085 COBRA®
			16x8	16x6	16x4	412		1" x 3" x 100'	1.5" x 3" x 100'
UP TO 1600	PR1/PR1D	480	8	11	19	22	6	44	30
	PR2D	600	10	14	24	28	8	55	38
	PR3XD	768	12	18	30	35	10	70	48
UP TO 2400	PR2D	600	10	14	24	28	8	55	38
	PR3XD	768	12	18	30	35	10	70	48
UP TO 3200	PR3XD	768	12	18	30	35	10	70	48
								SQ. FT. REQUIRED	

*Always have a balanced ventilation system. In no case should the amount of exhaust ventilation exceed the amount of intake ventilation.

ROOF PITCH EXAMPLES:


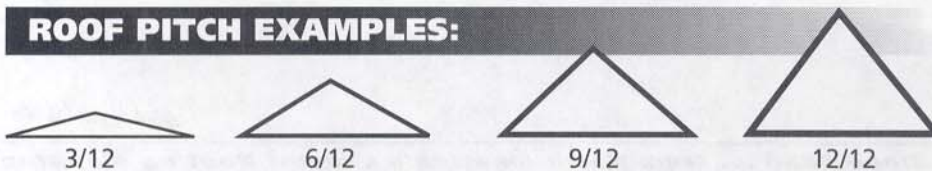


NOTE: When using more than one roof mounted power vent, it is critical that adequate intake ventilation, preferably under-eave or soffit, is available. If only gable lower intake is available, never install more than one roof mount power vent.

NR = NOT RECOMMENDED



2

- Locate the unit high on the roof, but below the ridge line.
- Single units should be centered, multiple units should be spaced evenly over the length of the roof.
- Measure from ridge line to center of power vent.
- Using the measurement from above, mark the location inside the attic centered between two rafters and drill a hole.
- Put an object through the hole to mark it outside.

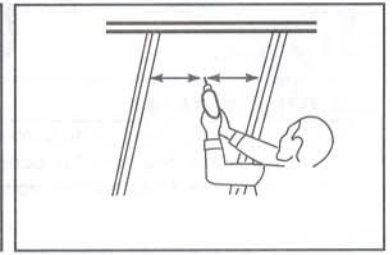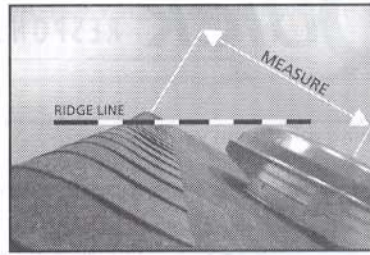

3


- Cut out the template located on the carton. Place center of cut out over hole marked in roof. Use as a guide to mark a circle. Cut out the opening.
- For rafters 16" on center, make the cutout as shown in Fig. 4-B.
- 15" Opening: MD105, MD105D, HI22D, PR1, PR1D, PR2D
- 17" Opening: PR3XD, PR3DHT, PSR10D, PSR10DHT

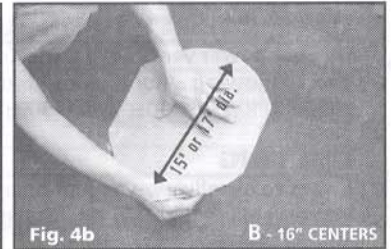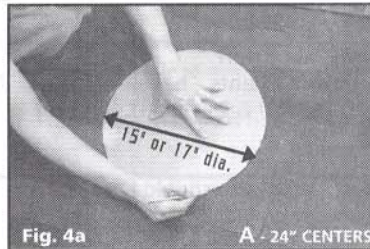

4

CUT OUT

Roll back and separate shingles and remove all nails from the area 5 1/2" from either side and 5 1/2" from the top of the hole.

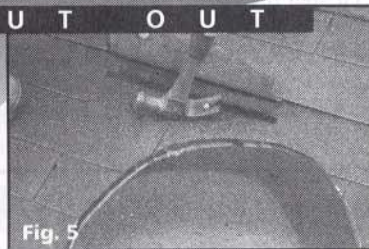


5

POSITION

Test the final position by inserting the flashing under the upper shingles.

Trim shingles if necessary. Remove unit and proceed to Step 6.

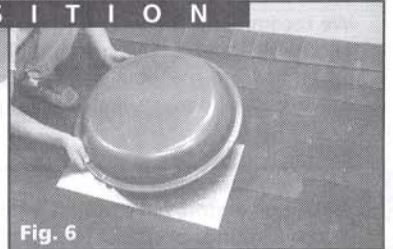

6

- Liberally apply roofing cement between each shingle layer ensuring a tight water seal.
- Liberally coat underside of flashing with roofing cement.
- Carefully slide unit under upper shingles, with arrow on flashing pointing up. Leave lower portion of flashing on top of shingles for weather protection
- Secure the unit in place with roofing nails at all corners and approximately every 4" along the edge.
- In severe storm areas, remove the vent hood and place roofing nails every 45° about 1" away from stack wall, then replace hood.
- Using roofing cement, seal all flashing and shingle edges, making sure that all raised shingles have been thoroughly caulked and pressed back into position.
- Seal all exposed nail heads. Seal between the flashing and stack. Seal all seams between the flashing stack and the vertical stack seam.



- For extra protection from water intrusion, seal all screws and rivets.


ALL UNITS

CAUTION: Automatically operated device. Disconnect power supply before wiring the ventilator into existing circuit. Be sure fan blades turn freely before restoring power. All wiring must be in accordance with state and local codes.

NOTE: FOR HOMES WITH A GAS FURNACE LOCATED IN THE ATTIC. The ventilator must be wired with a switch or other interlocking device to prevent the furnace and ventilator from operating at the same time during the heating cycle. We recommend that this switch (not provided) be installed by a qualified person in accordance with all applicable codes and standards.

7


ALL ROOF MOUNT UNITS



WIRING--All Units, PT-6 Thermostat

- Remove the thermostat cover.
 - Mount the thermostat to the edge of an adjacent stud or rafter using pre-punched holes in the box as shown in Fig. 8a.
 - Make sure that the thermostat element opening on the back of the box isn't covered.
 - Leave the flexible conduit somewhat slack.
 - Wire the thermostat as shown in Fig. 8b.
 - The PT-6 is adjustable from 60°F to 120°F.
 - The recommended temperature setting, for best energy savings, is 105°F.
- Each Power Vent Must Have Its Own Thermostat.**

Fig. 8b
PT6

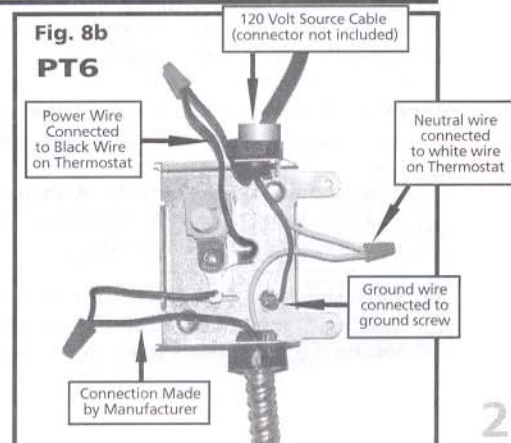

APPLICATIONS

- Can I use a power vent to do something other than vent my attic?
 Power vents are designed for general venting of attics. They are NOT recommended for venting ovens or other cooking appliances, paint fumes, sawdust, indoor pools, jacuzzis, saunas, showers, tubs or hazardous or explosive vapors or materials.

CFM

- What does 'CFM' mean?
 Cubic Feet Per Minute. In this case, it is the cubic feet of air that a fan will move in one minute.

DADE COUNTY APPROVAL

- Do your power vents have Dade County approval?
 The following Roof Mounted Power Vents have received Dade County Approval: PR1D, CPR1D, PR2D, CPR2D, PR2DHT, PR3XD, PR3DHT, MD105D, HI22D, PSR10D & PSR10DHT.

DUCTING

- I want to install a power vent on a duct. What size should I use?
 Power vents should NOT be installed on any type of duct.

EXHAUST VENTS

- What should I do with the exhaust vents that are on my roof after I install the power vent?
 We recommend that you remove or block other exhaust vents when you install a power vent. This includes roof louvers, ridge vent, and gable louvers. This prevents them from acting as intake vents when the power vent is running. If left open, air may 'short cycle,' entering from roof louvers close to the power vent and back out again, leaving large areas of the attic stagnant. The exposed roof louvers are also more likely to pull in rain or snow.

FIRE

- Can the motor catch fire?
 All of our motors have a built-in, thermally operated overload switch, which will interrupt power to the motor in the event that the motor windings overheat for any reason.

FIRESTAT

- What is a Firestat?
 It's a temperature operated safety device that stops fan operation if the temperature gets high enough to indicate the possibility of a fire. This keeps the appliance from fanning the fire.

- Do the units come with Firestats?
 No, the UL/CSA tested and approved thermal overload sensor in the motor provides sufficient protection. If local codes require a separate firestat, we recommend that a licensed HVAC or Electrical contractor be contacted for installation.

HUMIDISTAT

- What is a Humidistat?
 A humidistat is used to operate a fan based on a rise in relative humidity instead of a rise in temperature. A humidistat can be used along with a thermostat to control both heat and moisture buildup. Our model H1 uses a moisture sensitive membrane which lengthens or shortens as the relative humidity changes.

- Do I need a Humidistat?
 Not everyone needs a humidistat. If you have noticed a problem with moisture condensing in your attic, you should consider installing a humidistat and check for items that can contribute to attic humidity.

- What causes attic moisture?
 Moisture, in the form of a gas, will travel with air from inside the house through ceiling materials and insulation into the attic. When the attic is cooler than the house, as in the winter, the air cools and loses its ability to hold this moisture which then begins to condense. Moisture comes from every day living activities such as cooking, bathing, and even breathing. Humidifiers add a great deal of moisture and can be a major factor, especially in homes which don't have a vapor barrier installed between the living areas and the attic. Also, be sure that all bathroom and kitchen exhaust fans and dryers are vented to the outside, not into the attic.

- What should I set the humidistat on in summer?
 You may want to set the humidistat to STOP in summer. This will keep it from running needlessly, as humidity control is in most instances only needed in winter.

- What should I set the humidistat on in winter?
 We recommend that you start by setting the humidistat at 70%. Monitor the attic conditions and adjust if necessary, lowering the setting if there appears to be an excess of moisture, raising it if the fan seems to run too long.

- ☹️ What is the amp rating on the H1 humidistat?
😊 The humidistat is rated for loads up to 7.5 amps at 120 volts. Each fan unit should have its own humidistat.

MOTOR

- ☹️ How often should I oil the motor?
😊 Our power vents do not require the motor to be oiled.

MOUNTING VERTICALLY

- ☹️ Can I put a Roof Mount Power Vent on a wall?
😊 The motor is suitable for all position mounting. However roof mounted units are not designed for and should not be mounted vertically. They will not keep out rain or snow in that position and the mounting itself will be less secure on a side wall.

THERMOSTATS

- ☹️ What temperature should I set the thermostat at?
😊 Recommended setting is 105° F, fan 'ON' temperature, for the most effective operation.
- ☹️ Can I use your thermostat on a 1/3 (etc.) hp motor?
😊 Check the motor to see if it will work. As a safety factor, the motor amps should not be more than 75% of the thermostat amp rating.
- ☹️ How high (or low) does the thermostat go?
😊 The PT6 thermostat adjusts from 60°F to 120°F.
- ☹️ What's the amp rating on the thermostat?
😊 Our thermostat has a maximum Full Load Amp (FLA.) rating of 6 amps at 120 volts. Each fan should have its own thermostat.
- ☹️ Can I run two units on one thermostat?
😊 Each fan should have its own thermostat. Running two or more units on one thermostat is not recommended.
- ☹️ Does it matter which black thermostat wire connects to the motor and which one connects to the house power?
😊 No, it makes no difference on the PT6 thermostat.

THERMOSTAT NOT ACCURATE

- ☹️ The fan doesn't turn off/on at the temperature setting. Is it defective?
😊 The thermostats which come with the single speed units are tested to be accurate to +/-5°F. The "differential" (the difference between the ON temperature and the OFF temperature), will vary from 5°F to 15°F degrees. While it may seem like a very broad range, these units are designed to vent hot air out of attics, an application which doesn't call for a high degree of accuracy. Installation may be a factor with units that don't turn off. There is an opening in the back of the thermostat box which must be left uncovered so that air can get into the thermostat element. If it is covered, it causes longer run times.

WIRING

- ☹️ What size wire should I use?
😊 The wire size to use depends on the size of the circuit breaker that controls the circuit on which the unit is installed. A 15-amp breaker requires a minimum 14-gauge wire. A 20-amp breaker requires a minimum 12-gauge wire.
- ☹️ What kind of wire should I use?
😊 Most codes permit the use of Romex type wire for most interior applications. If there is any doubt, customers should check with their local building dept.
- ☹️ Can I use an extension cord and just plug it in?
😊 NO, the unit should not be wired using an extension cord. It should be wired according to national and local codes, to a 120 V, 60HZ, grounded circuit.
- ☹️ Do I have to put in a new circuit for this power vent?
😊 In most cases, these units can be installed on an existing circuit without a problem. Occasionally, they may cause a circuit, which is already at or close to maximum capacity, to overload. A breaker which trips occasionally, even though all the appliances on the circuit seem to be working well, may indicate the need for a new circuit.

WIRING WITH ATTIC FURNACE

- ☹️ Your instructions say to install a special switch because I have a furnace in my attic. Why?
😊 The concern is when the furnace, and this applies only to gas or oil furnaces, operates in heating mode. It is not a problem if the power vent runs when the air conditioning is running. Additionally, heat pumps with electric heat elements, and all electric furnaces are not affected by power vents. There are occasions, in Spring and Fall, when temperatures are such that your attic may be warm enough for the power vent to come on even though the house is cool enough for the furnace to operate. At these times it is possible for the power vent to disrupt the draft in the furnace flue, causing combustion products to concentrate in the attic space and creating the potential for flue gases to get into the living area. Using a power vent with a humidistat will also create periods when both the furnace and power vent will operate simultaneously. The best course, particularly when a humidistat is installed on the power vent, is to have a licensed electrician or heating and air contractor install a lockout relay which will automatically cut the power vent when the furnace comes on. The minimum precaution is a switch which will turn the power vent off during the heating season.